


# DISPOSITION

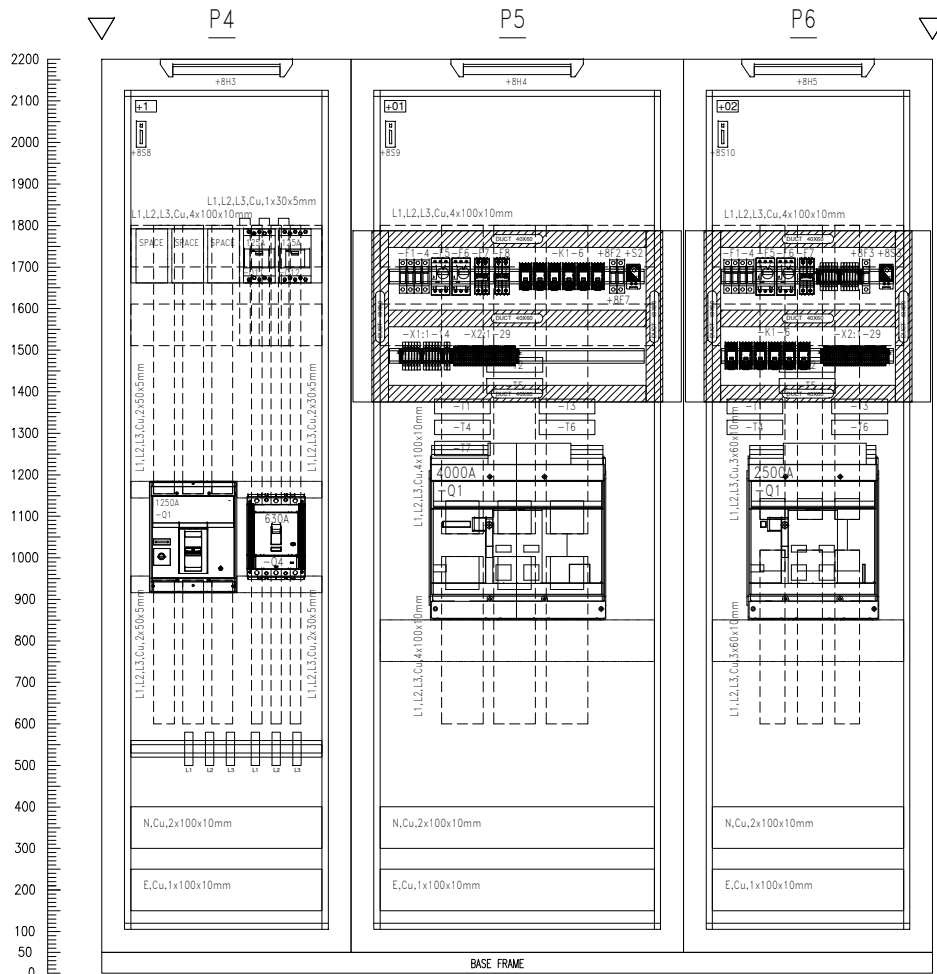

OUTGOING-1



INCOMING-1 FROM  
TURBINE GENERATOR  
2000KVA  
TP ,ACB 4000A

INCOMING-2 FROM  
GENERATOR G1  
1000KVA  
TP ,ACB 2500A


# SIDE VIEW

Depth = 1000mm

▽ PANEL DISCONNECTION

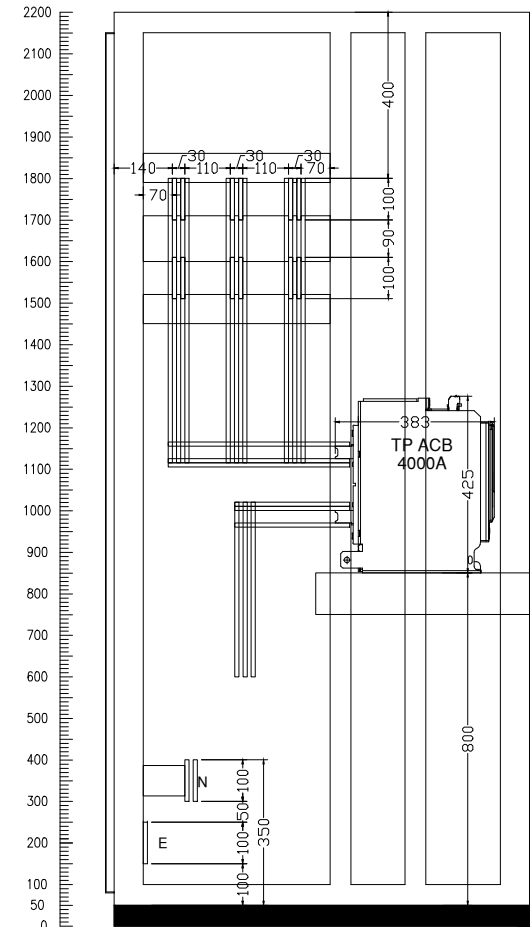

INCOMING-1 FROM  
TURBINE  
TP ,ACB 3200A

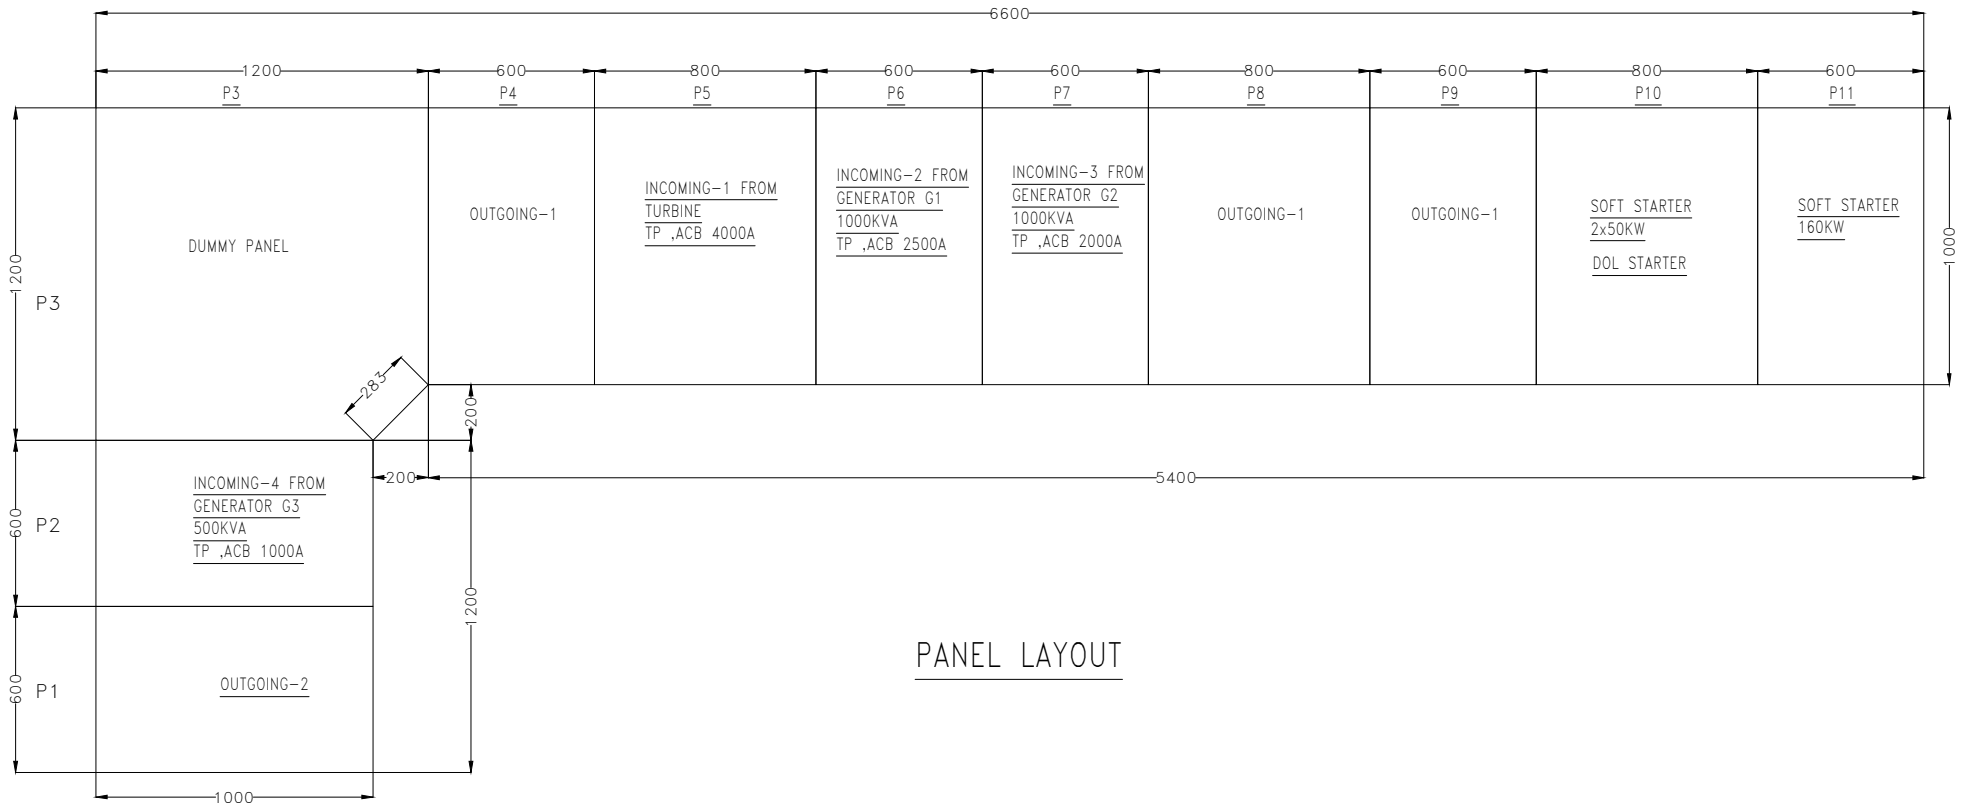

PANEL LAYOUT